
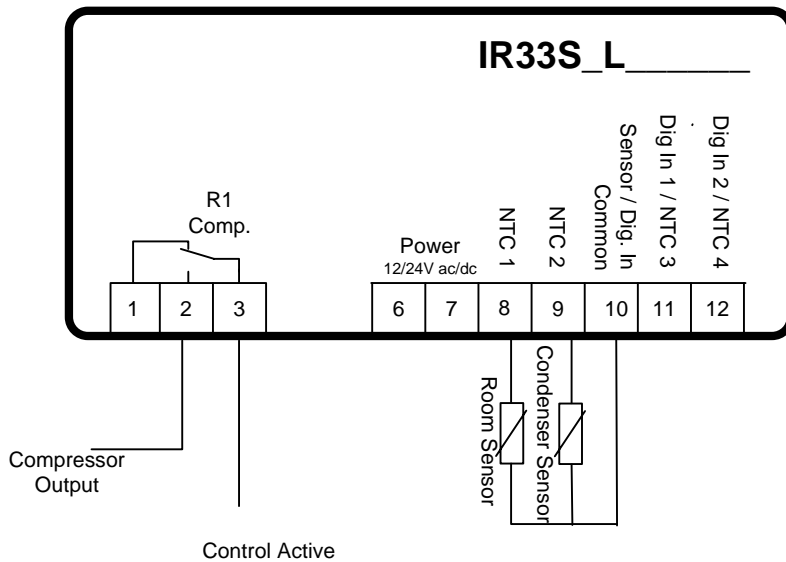


#### SETPOINT (Cutout) ST1

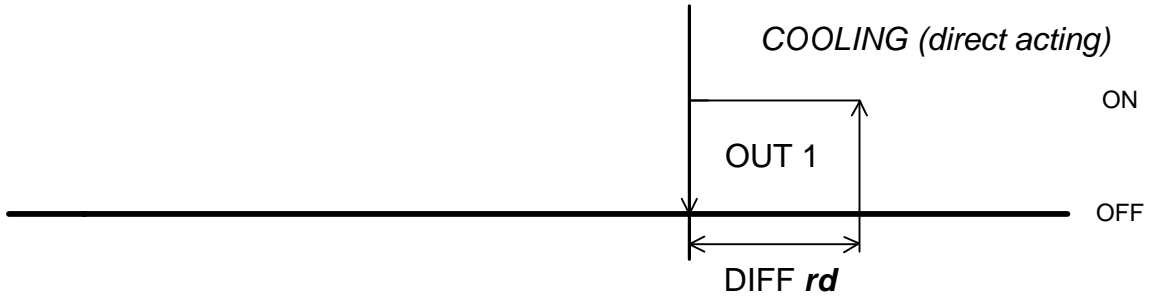

PARAMETERS
/A2 = 2 (NTC2 = Cond Probe)
rd = Differential
dl = Defrost Interval
dP1 = Defrost Duration
Ac = High cond Temp alarm set point
AE = High cond. Temp differential
Acd = High cond. Temp delay
<b>NOTE: Pre "clean cond" alarm "cht" (non critical) occurs at Ac - 1/2 AE</b>